


SINGLE SERVICE

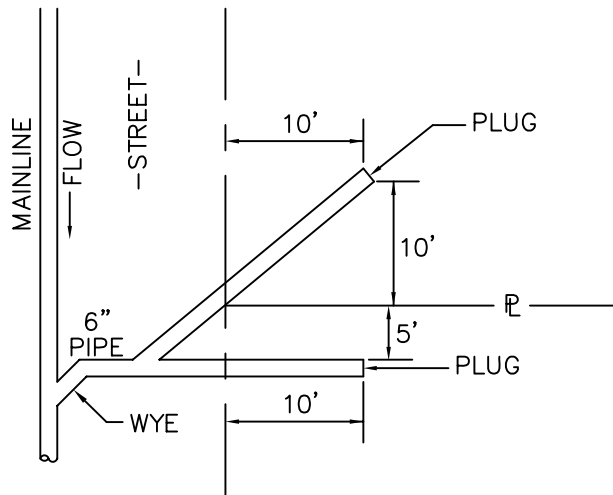

DOUBLE SERVICE

NOTES:

1. WHERE SIDE SEWER CONNECTS TO MANHOLE:
INVERT OF SIDE SEWER SHALL BE EQUAL TO OR ABOVE MAIN SEWER CROWN, BUT NOT TO EXCEED 18" ABOVE INVERT OF MAIN SEWER.
(FOR COMMERCIAL AND MULTIFAMILY APPLICATIONS ONLY)
2. UNLESS OTHERWISE INDICATED ON PLAN,
SIDE SEWER SHALL BE MIN. OF 6' DEEP AT PROPERTY LINE, OR 5' LOWER THAN THE LOWEST ELEVATION, WHICHEVER IS LOWER.
3. TRENCH BACKFILL SHALL BE PER CITY OF KIRKLAND STD. PLAN NO. CK-S.01.

CITY OF KIRKLAND

PLAN NO. CK-S.19A



SIDE SEWER STUB
"PLAN VIEW"