


P.R.V. SHALL HAVE AN INTEGRAL BYPASS

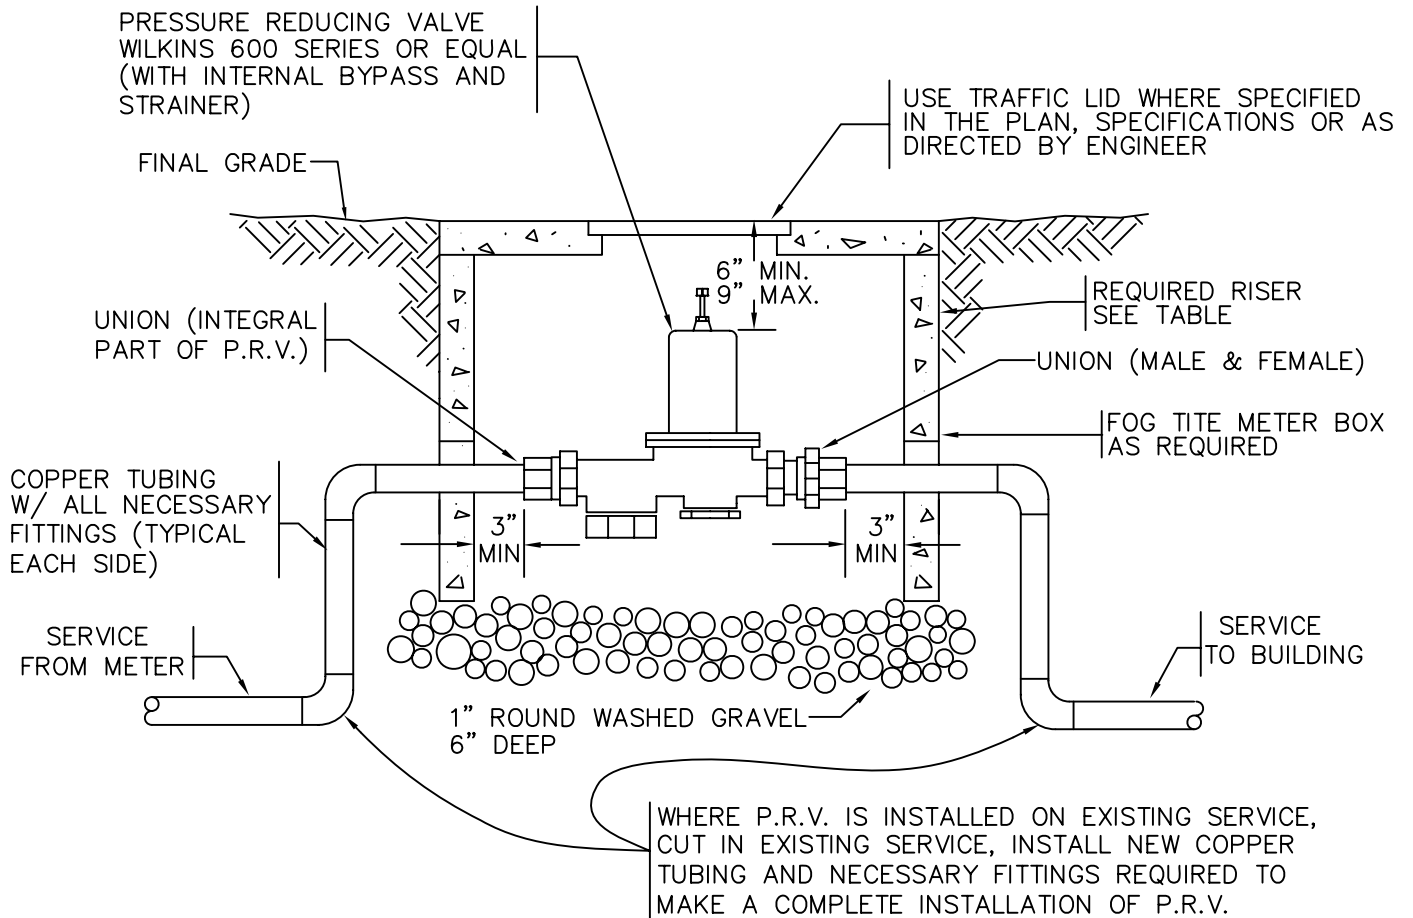

P.R.V. SIZE	FOG TITE METER BOX NO.	RISER REQUIRED
2"	2	12"
1 1/2"	2	12"
1 1/4"	1	6"
1"	1	6"
3/4"	1	4"
1/2"	1	4"

CITY OF KIRKLAND	
PLAN NO. CK- W.29	
	INDIVIDUAL PRESSURE REDUCING VALVE ASSEMBLY RESIDENTIAL