


SIDE VIEW

NTS

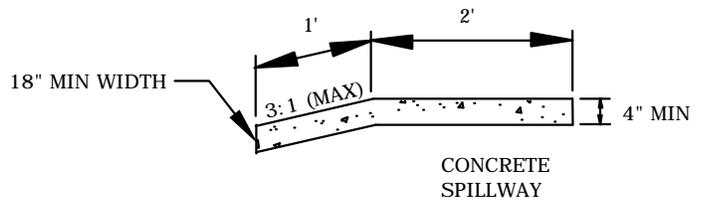


RAIN GARDEN SHAPES WILL VARY. SHAPE AND PLANTS SHOWN IN DIAGRAM ARE FOR ILLUSTRATION PURPOSES ONLY.

PLANTING ZONES	
ZONE 1:	AREA WITH FREQUENT STANDING WATER.
ZONE 2:	AREA WITH OCCASIONAL STANDING WATER, AND EXTENDED DRIER PERIODS.
ZONE 3:	AREA WITH DRIER CONDITIONS.

NOTES

1. MAXIMUM BOTTOM SLOPE OF CELL IS 0.5%.
2. OVERFLOW POINT SHALL BE AT LEAST 6" BELOW ANY ADJACENT PAVEMENT AREA.
3. MINIMUM 3' DEPTH BETWEEN BOTTOM OF BIORETENTION SOIL MIX (BSM) AND WATER TABLE.
4. INSTALL STREAMBED COBBLE (1" - 4") AT INLET TO DISSIPATE RUNOFF. PLACE COBBLE AT SLIGHTLY HIGHER ELEVATION THAN INLET ELEVATION.
5. BSM SHALL CONTAIN THE FOLLOWING:
 - AGGREGATE TO COMPOST RATIO: 60% MINERAL AGGREGATE (WITH LESS THAN 5% FINES), 40% MAX COMPOST (MEET WAC 173-350-220)
 - TOTAL BSM ORGANIC MATTER CONTENT OF 4-8% (BY DRY WEIGHT)
 - BSM DEPTH OF 12-24". ENHANCED TREATMENT REQUIRES MIN DEPTH OF 18"
6. MINIMUM SETBACK OF 5' FROM TOP OF BIORETENTION CELL TO BUILDING STRUCTURES AND PROPERTY LINES. DO NOT LOCATE IMMEDIATELY UPSLOPE OF BUILDING STRUCTURES.
7. SITE SPECIFIC LANDSCAPE MUST MEET BIORETENTION PLANT DESIGN CRITERIA LOCATED IN STORM LID SECTION OF THE PRE-APPROVED PLANS.
8. MAX 3" MULCH LAYER IN PONDING AREA AND ON SIDE SLOPES. MULCH MUST BE ARBORIST OR PLAYFIELD WOOD CHIPS WITHOUT BARK, CONSISTING OF SHREDDED OR CHIPPED HARDWOOD. MULCH SHALL NOT CONTAIN WEED SEEDS, GRASS CLIPPINGS, OR BARK.
9. FOR CELLS IN PARKING LOTS, ADD NARROW GRAVEL FOOT PATHS ACROSS CELLS FOR FOOT TRAFFIC.

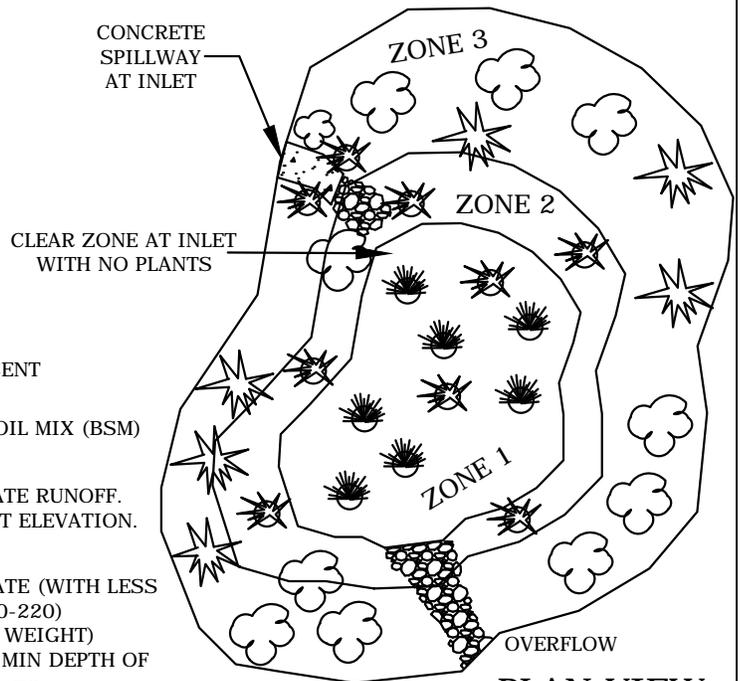

NTS

CITY OF KIRKLAND

PLAN NO. CK-L.02



**BIORETENTION CELL
OVERLAND I/O**