


CURB RADIUS AT INTERSECTIONS

	ARTERIAL	COLLECTOR	NEIGHBORHOOD ACCESS
ARTERIAL	35'	35'	30'
COLLECTOR	X	30'	30'
NEIGHBORHOOD ACCESS	X	X	25'

NOTES

1. STORM DRAINAGE INLETS SHALL BE OUTSIDE THE CURB RAMP.
2. THE CURB RAMP MAY BE MOVED AWAY FROM THE CROSSWALK TO AVOID CONFLICTS WITH HYDRANTS, POLES, INLETS OR OTHER UTILITIES, EXCEPT WHERE THE STREET GRADE EXCEEDS 4%.
3. FOR SWEEPING EFFICIENCY WHEN CURB BULBS (PARKING SETBACKS) ARE USED, REVERSE CURVE RADII SHALL NOT BE LESS THAN 15 FEET. REFER TO DETAIL A.
4. FOR STAKING PURPOSES, RAMPS MAY BE LOCATED PER QUARTER DELTA AND PUBLIC WORKS APPROVAL.

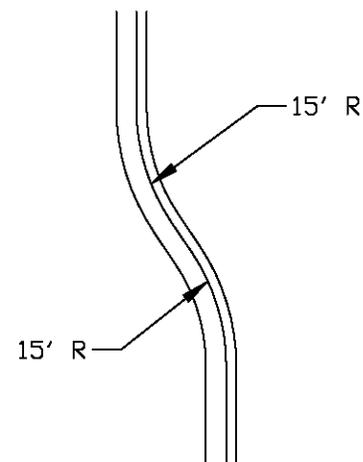

DETAIL A – MINIMUM RADIUS FOR CURB BULB/PARKING SETBACK

CITY OF KIRKLAND	
PLAN NO. CK-R.24	
	CURB RADIUS STANDARDS & CURB RAMP LOCATIONS