


ISOMETRIC VIEW

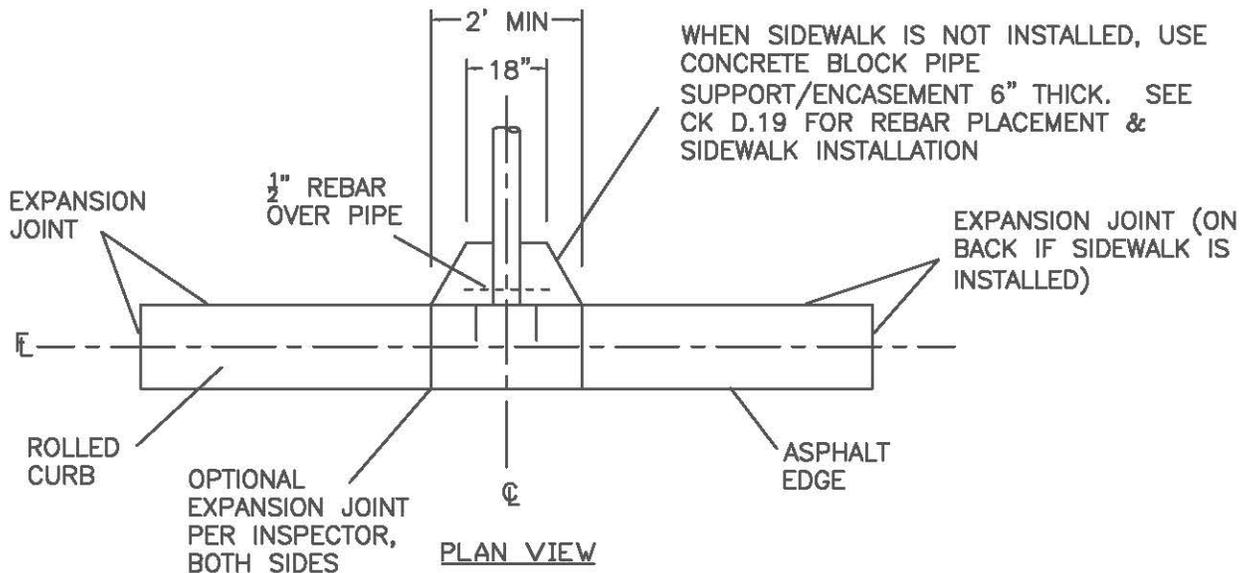

PLAN VIEW

NOTES

1. PIPE SHALL BE 3" DIA PVC PLASTIC PIPE (SCH 40).
2. CEMENT CONCRETE SHALL BE CLASS B (3/4").
3. REINFORCING BAR SHALL BE #3 (3/8" DEFORMED BAR
4. SIDEWALK AND CURBING MUST BE SAW-CUT AT A DUMMY JOINT OR REMOVED TO A FULL EXPANSION JOINT.
5. SIDEWALK THICKNESS OF 4" MINIMUM.
6. FULL DEPTH OF CURB AND GUTTER MUST BE REMOVED AND REPLACED.

CITY OF KIRKLAND	
PLAN NO. CK-D.19A	
	ROLL CURB ROOF DRAIN OUTLET