

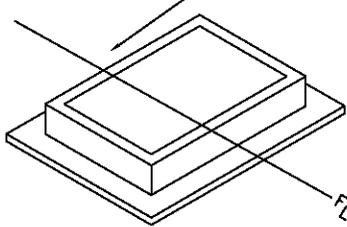
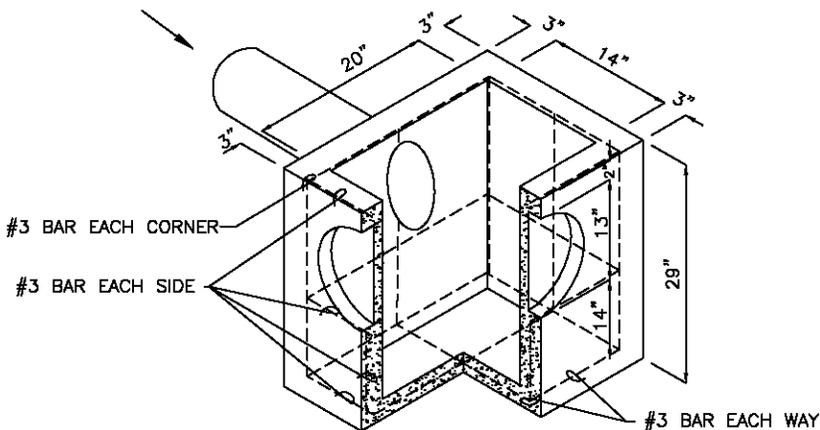


ALIGNMENT OF STRUCTURE
TO PIPE FLOWLINE, TYP.

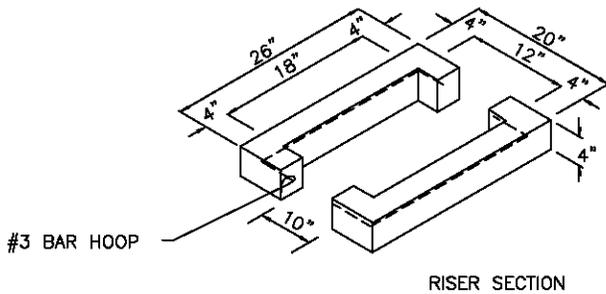

FRAME AND SOLID LOCKING LID
STANDARD DETAILS D.16A AND D.17

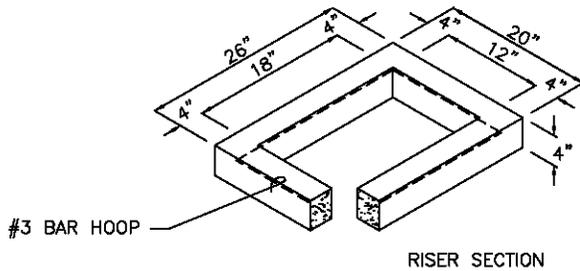

PRECAST BASE SECTION
(MEASUREMENT AT THE
TOP OF THE BASE)

NOTES:

1. INSTALL TYPE 40 LEVEL.
2. INSTALL A 4" RISER NOTCHED, 10" ON EACH SIDE PERPENDICULAR TO INLET PIPE. MORTAR IN PLACE.
3. INSTALL 2ND 4" RISER INTACT, FLIP FRAME AND INSTALL SOLID LOCKING LID.
4. INSTALL RIP-RAP CHANNEL WITH LEVEL BERM ON DOWNSTREAM EDGES.

CITY OF KIRKLAND	
PLAN NO. CK-D.29A	
	ENERGY DISSIPATOR CATCH BASIN