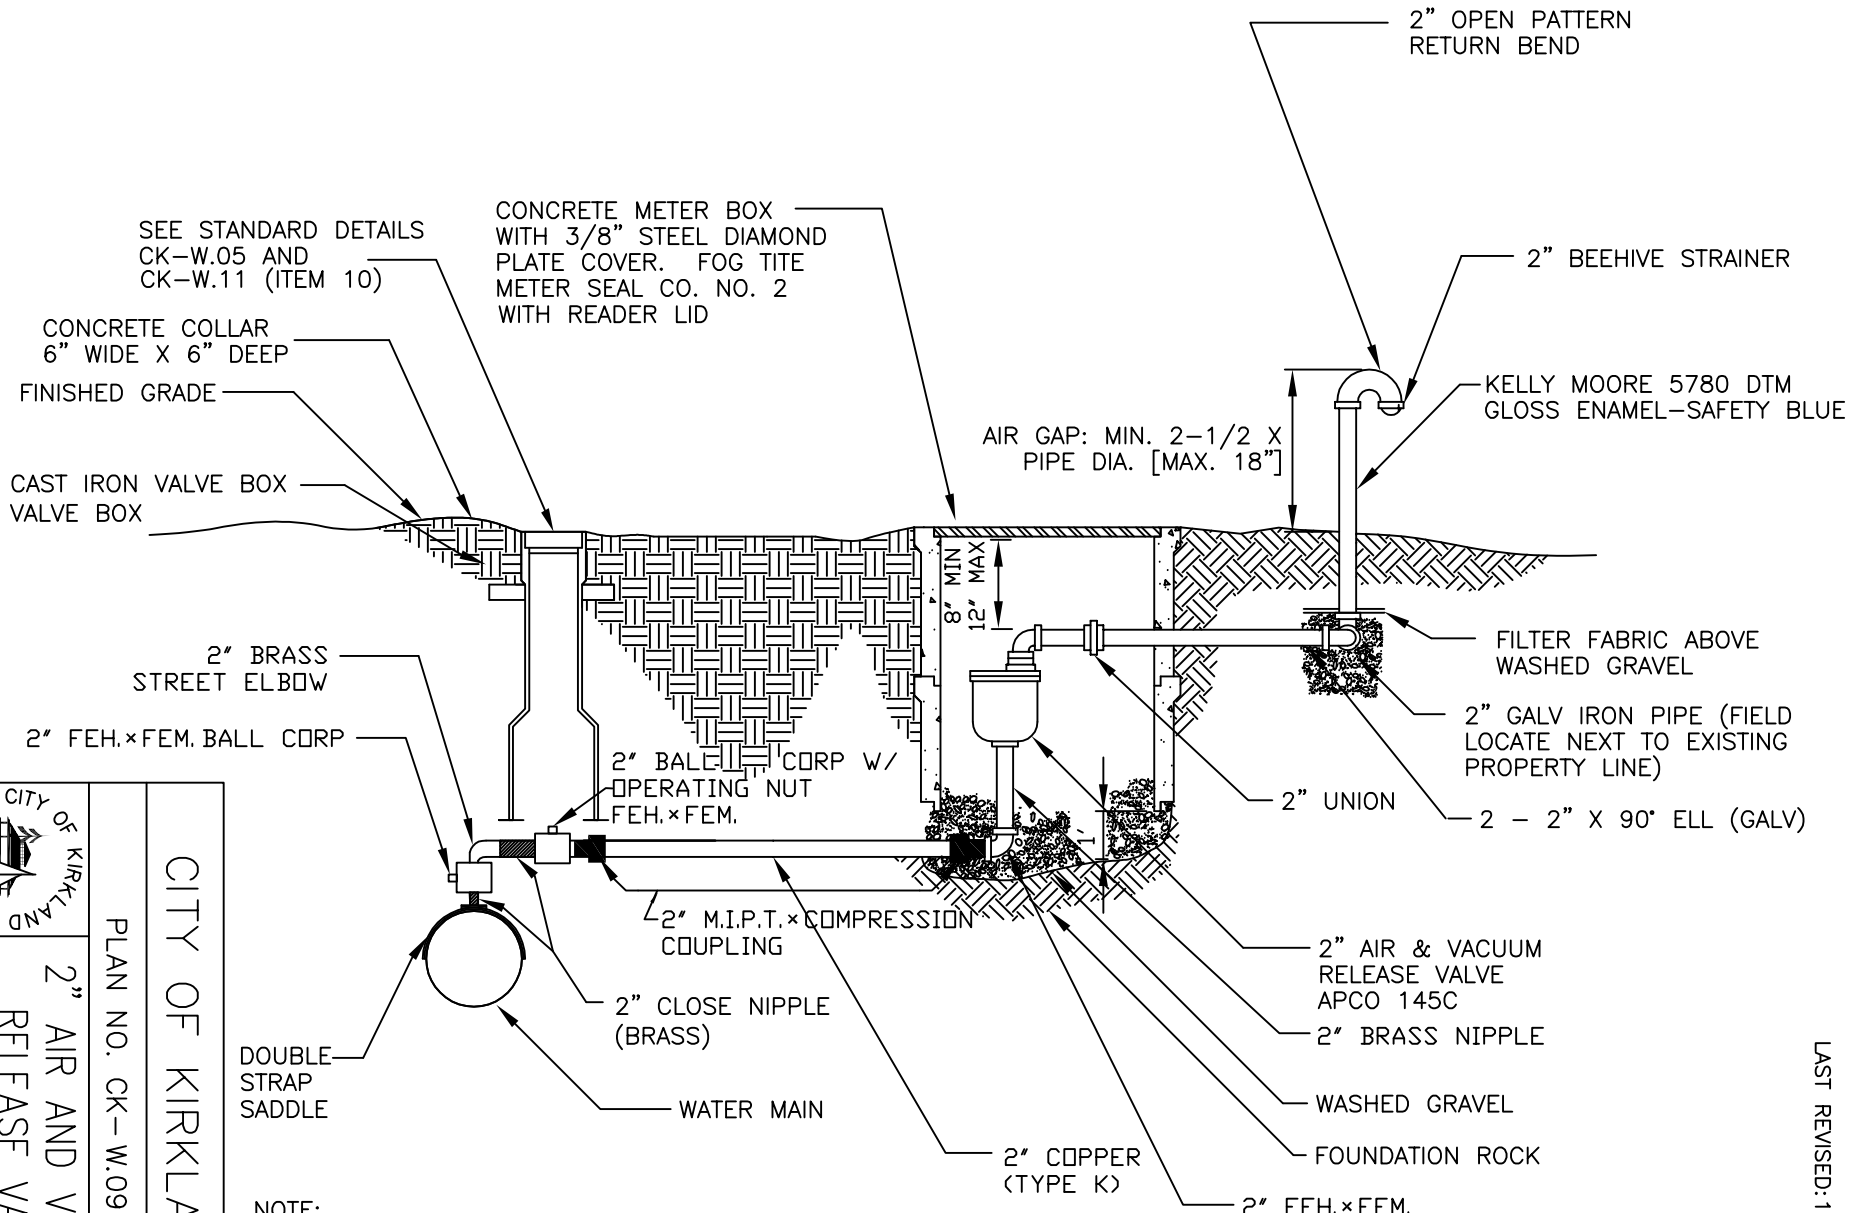


NOTE:
TRACER WIRE FROM MAIN TO SERVICE METER MUST BE INSTALLED IN ALL INSTALLATIONS. WIRE MUST BE WRAPPED AROUND STOP AND THE CORPORATION STOP, WITH LAST 8" STRIPPED.

CITY OF KIRKLAND

PLAN NO. CK–W.09

2" AIR AND VACUUM RELEASE VALVE ASSEMBLY

LAST REVISED: 1/15/15