



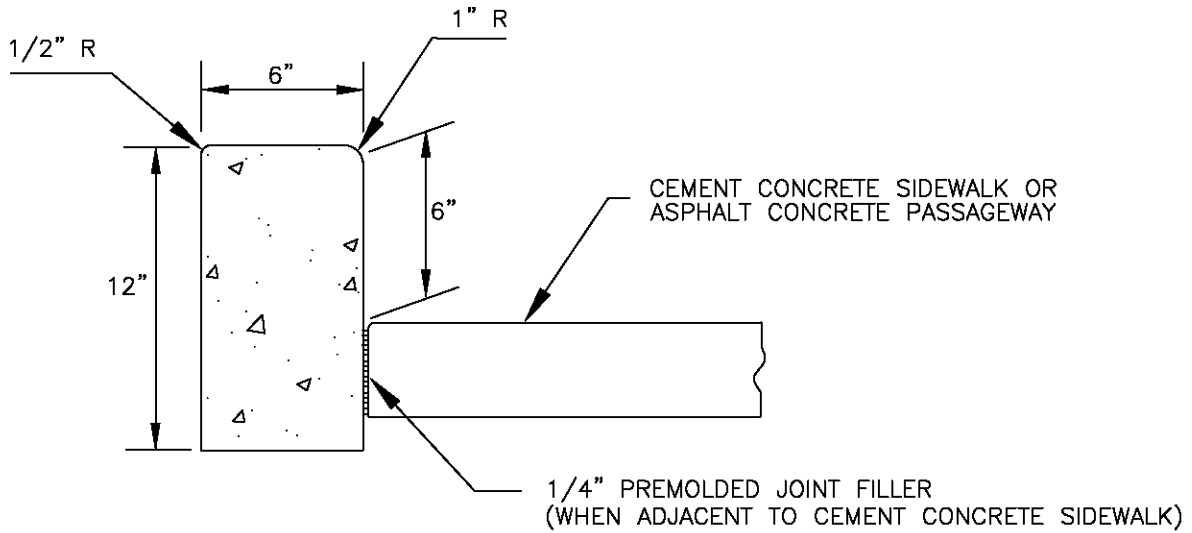

CEMENT CONCRETE PEDESTRIAN CURB

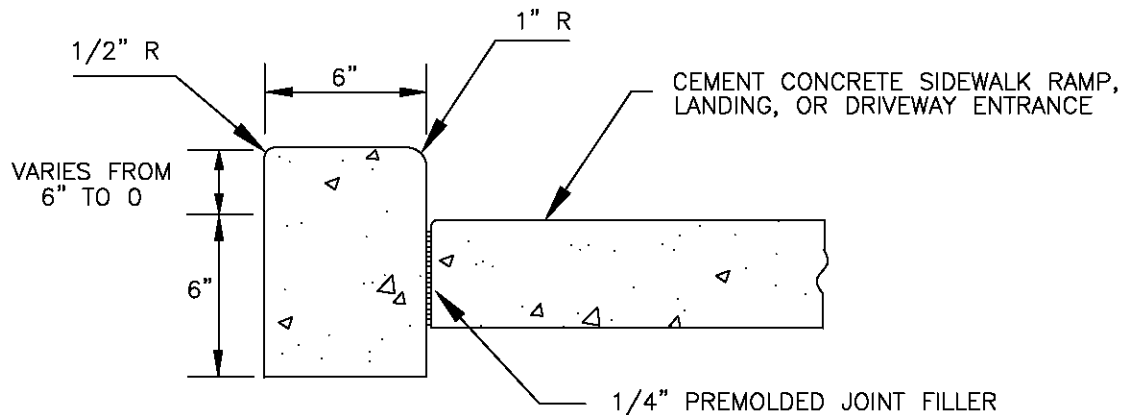

CEMENT CONCRETE PEDESTRIAN CURB

AT SIDEWALK RAMPS & LANDINGS, AND DRIVEWAY ENTRANCES

NOTES

1. FORMS SHALL BE STEEL AND SET TRUE TO LINE AND GRADE (INSPECTION REQUIRED PRIOR TO PLACEMENT OF CONCRETE).
2. CONCRETE SHALL BE CEMENT CONCRETE CLASS 4000.
3. BASE COURSE SHALL BE 4" OF 5/8" MINUS CRUSHED ROCK.
4. SEE CK-R.17 FOR CURB EXPANSION AND CONTRACTION JOINT SPACING.

CITY OF KIRKLAND

PLAN NO. CK-R.17A



CEMENT CONCRETE
PEDESTRIAN CURB