




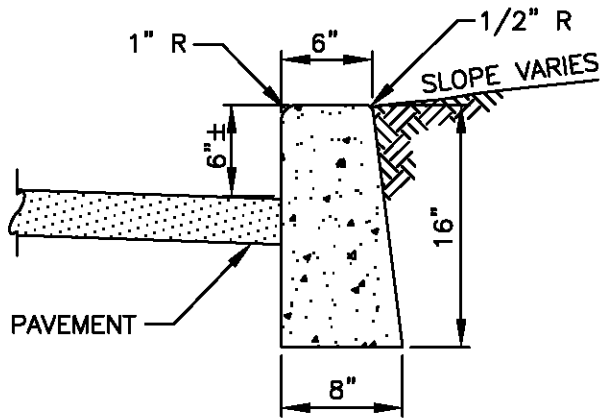


TYPE E-1 CURB

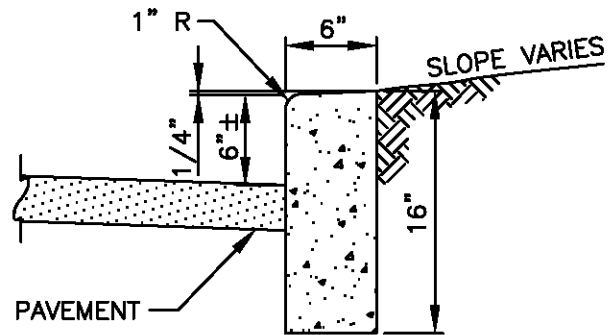

TYPE E-2 CURB

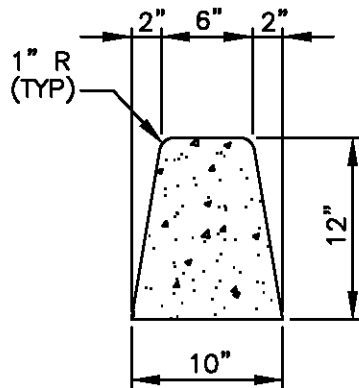

TYPE E-3 CURB

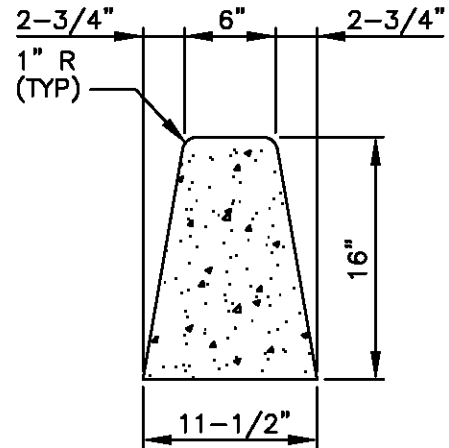

TYPE E-4 CURB

NOTES

1. DUMMY JOINTS SHALL BE PLACED NOT TO EXCEED 15' CENTER TO CENTER, THEY SHALL BE NOT LESS THAN 3/16" IN THICKNESS AND SHALL EXTEND 2' BELOW THE GUTTER LINE.
2. 3/4" THRU JOINTS SHALL BE PLACED AT ALL COLD JOINTS OR AS DIRECTED BY THE ENGINEER AND SHALL EXTEND 1" BELOW BOTTOM OF CONCRETE.
3. MATERIALS SHALL MEET THE REQUIREMENTS OF THESE SPECIFICATIONS.
4. CONCRETE SHALL BE CEMENT CONCRETE CLASS 4000.

CITY OF KIRKLAND

PLAN NO. CK-R.18



CEMENT CONCRETE
CURB E-1, E-2,
E-3 & E-4