



CROSS SECTION

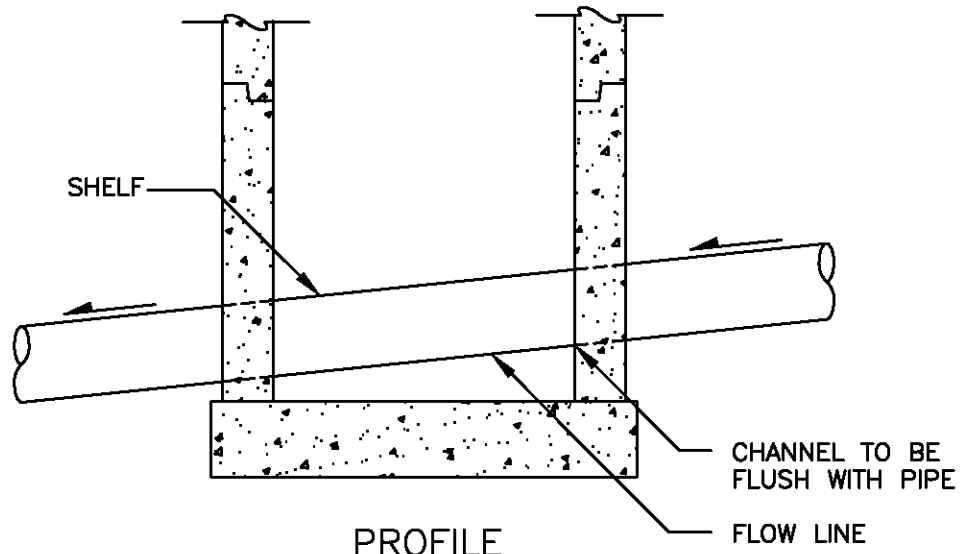


PROFILE

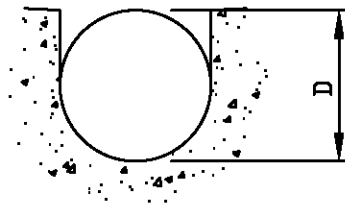

CHANNEL SECTION

NOTES

1. DEPTH OF CHANNEL MUST BE SAME AS PIPE DIAMETER.
2. MINIMUM 0.1' DROP ACROSS CHANNEL;
MAXIMUM 1.0' DROP ACROSS CHANNEL.

CITY OF KIRKLAND	
PLAN NO. CK-S.13	
	SEWER MANHOLE MAIN CHANNEL AND SHELF