



D.I. PIPE SHALL BE ONE CONTINUOUS
PIECE OF PIPE AND SHALL EXTEND A
MINIMUM OF 24" ONTO UNDISTURBED SOIL

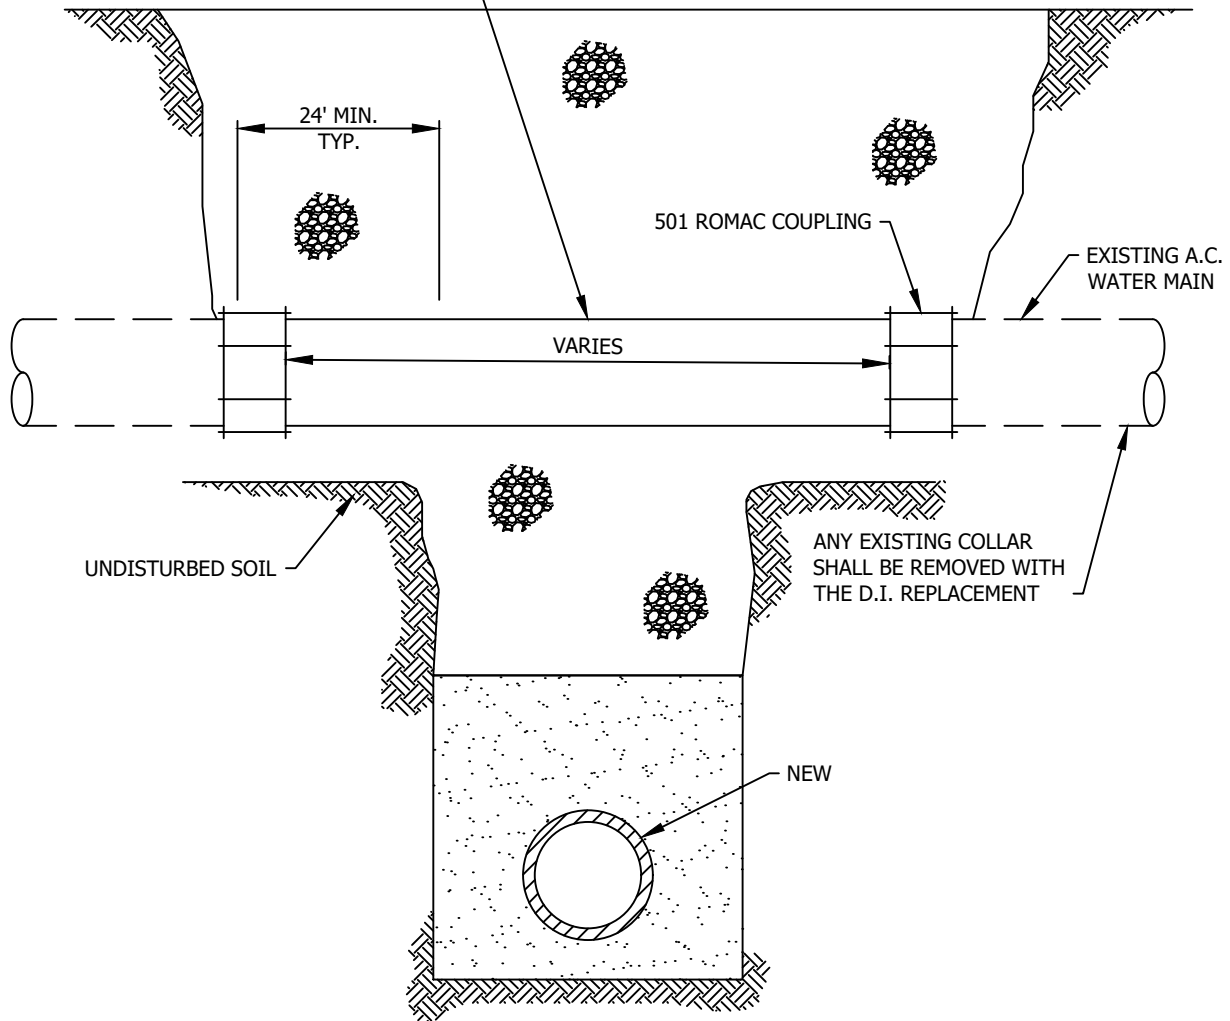

NOTES:

1. ALL APPLICABLE ENVIRONMENTAL PROTECTION AGENCY, PUGET SOUND AIR POLLUTION CONTROL AGENCY, AND LABOR AND INDUSTRY REQUIREMENTS AND REGULATIONS SHALL BE MET IN CUTTING, REMOVAL, HANDLING, AND DISPOSING OF A.C. PIPE.
2. CONTRACTOR SHALL SWAB AND/OR SPRAY D.I. WATER MAIN AND TRANSITION COUPLINGS WITH 1% HYPOCHLORITE SOLUTION PRIOR TO INSTALLATION.
3. THE D.I. PIPE REPLACEMENT IS REQUIRED ANYTIME THE CROSSING IS UNDER AN A.C. MAIN AND A "SOIL BRIDGE" CANNOT BE MAINTAINED OR THE CROSSING IS UNDER A COLLAR OR MILL OR AS DIRECTED BY PUBLIC WORKS. ALL PARTS MUST BE ON-SITE AND INSPECTED PRIOR TO SHUT DOWN REQUEST. A.C. MAIN MUST BE POT HOLED ON BOTH SIDES OF THE CROSSING AND AN O.D. MEASUREMENT TAKEN PRIOR TO ACQUIRING THE ROMAC 501 COUPLINGS. THE CONNECTION WILL BE VISUALLY INSPECTED UNDER SYSTEM PRESSURE AFTER INSTALLATION.

CITY OF KIRKLAND	
PLAN NO. CK- W.24	
	AC WATERMAIN CROSSING