


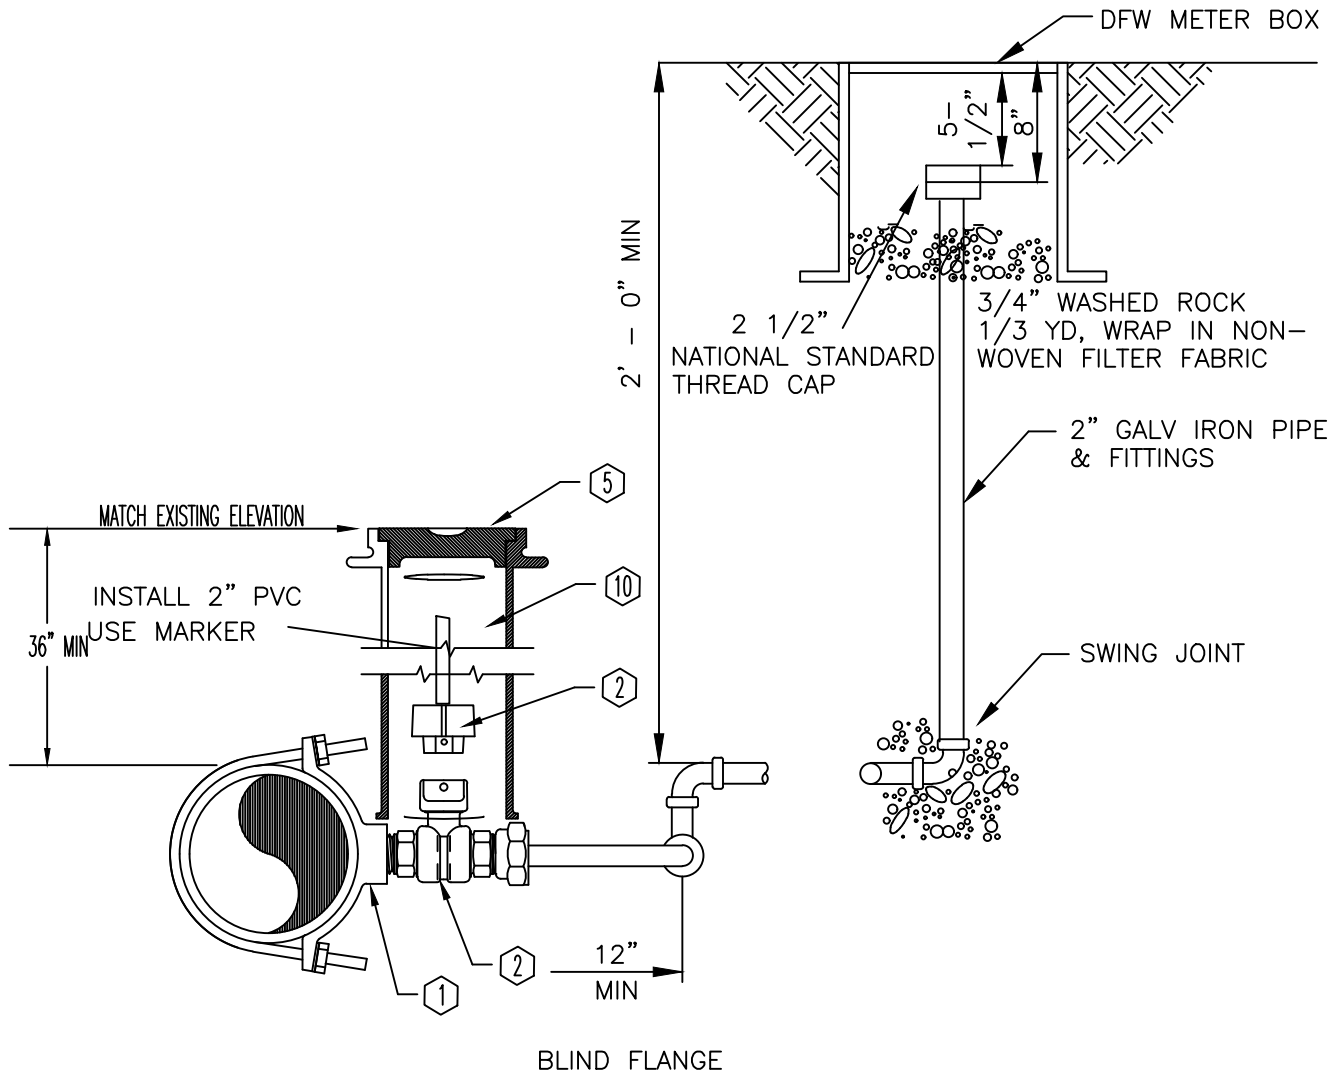

WATER SERVICE STANDARDS
1-1/2" & 2" Copper Services

NOTES:

1. IF MAIN WILL BE EXTENDED IN THE FUTURE, A MAINLINE GATE VALVE IS TO BE INSTALLED A MINIMUM OF ONE FULL LENGTH OF PIPE UPSTREAM OF THE B.O.
2. A BLOW OFF MAY NOT BE USED ON A MAIN LINE PERMANENTLY DEAD ENDED - FIRE HYDRANT ONLY.

DESCRIPTION	MAKER OR RATING	2"
1. Double Strap Saddle	Romac or Equal	202 IPT
2. Ball Valve-2" Operating Nut w/Cotter Pin	Ford or equal	B11-777 w/Qt67
5. Valve Box	Rich or Equal (940-B LOCKING)	
10. 2" Marker	PVC	

CITY OF KIRKLAND

PLAN NO. CK-W.11



2" BLOW-OFF
ASSEMBLY